

KEY



COMMON EQUIPMENT CABINET



POWER DISTRIBUTION POINT
(TP/TEDP)

(FO)



Fibre Optic cable

(5 x LF)

Loop Feeder Cables -
number in brackets
denotes number of cables

(PC)

Power supply cable

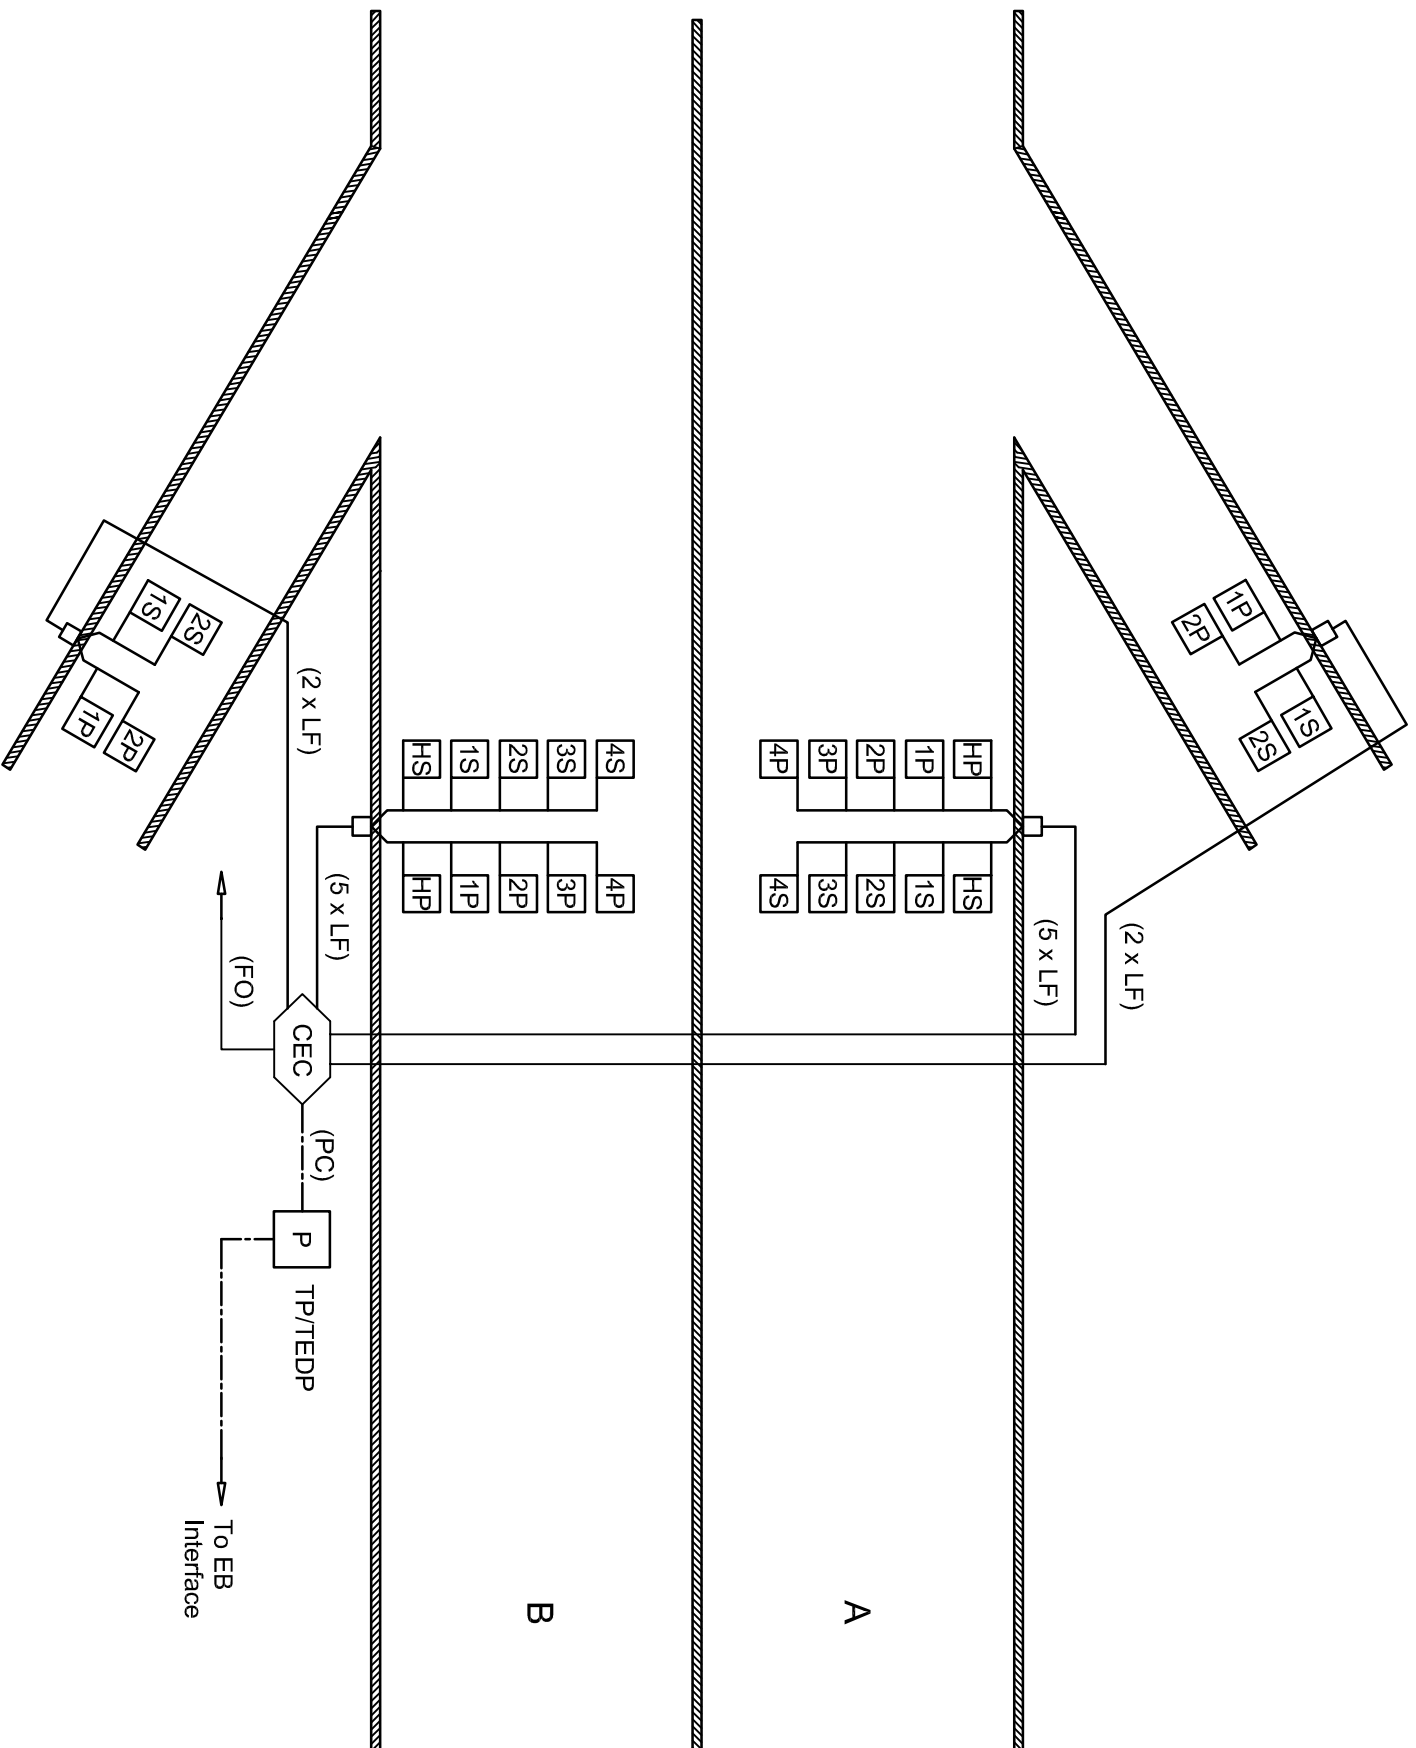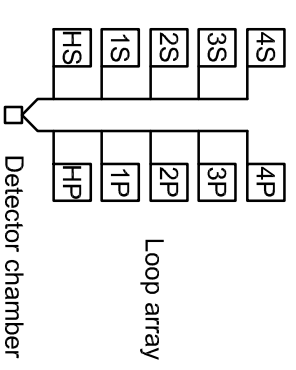

Note:
The NDX series of drawings represents non site specific installations of standard equipment and site layouts.

This drawing was generated on computer and must not be manually updated

TYPICAL DETECTOR LOOP SITE

ORIGINAL DRAWING SIZE: 297 x 420	DRN	C.S.G.	CHKD	B.D.	SCALE
ALL DIMENSIONS ARE IN MM	DATE	15.07.02	DATE	19.07.02	N.T.S.
TOLERANCE +- 1 UNLESS OTHERWISE STATED	DRG. NO.	NDX1007-01cl			SHT. NO.
THIRD ANGLE PROJECTION DO NOT SCALE					2 of 3
	ISSUE	AMENDMENTS			APPD/DATE
	B	SEE REVIEW SHEET			GC 26/09/06
	D	UPDATED SEE REV. SHT.			BD 30/11/09
	C	REDRAWN			BD 13/10/09