


NOTES  
 BEFORE CAPPING, THE CABLE SHALL BE CUT SQUARE AND THE LENGTH OF CABLE TO BE CAPPED SHALL BE THOROUGHLY CLEANED USING A DRY CLEAN CLOTH OR CLEANING FLUID APPROVED BY THE CABLE MANUFACTURER FOR THE PURPOSE.



This drawing was generated on computer and must not be manually updated

TYPICAL METHOD OF SEALING UNUSED CABLE ENDS

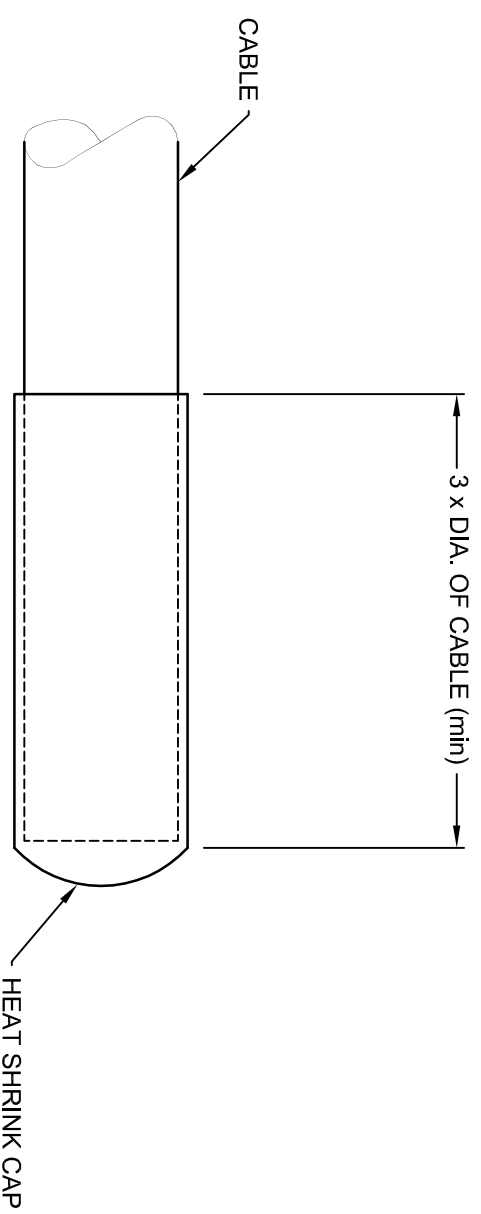

Note:  
 The NDX series of drawings represents non site specific installations of standard equipment and site layouts.

ORIGINAL DRAWING SIZE: 297 x 420		DRN C.S.G.		CHKD B.D.	SCALE
ALL DIMENSIONS ARE IN MM		DATE 01.12.01	DATE 01.12.01		N.T.S.
TOLERANCE +- 1 UNLESS OTHERWISE STATED		DRG. NO. NDX1061-00dt		SHT. NO. 2 of 6	
THIRD ANGLE PROJECTION DO NOT SCALE					
A	FOR INFORMATION			BD 09/02/03	
2	MODIFIED AS PER REV SHT			BD 07/01/02	
B	REDRAWN			BD 13/10/09	
ISSUE	AMENDMENTS	APPD/DATE			