
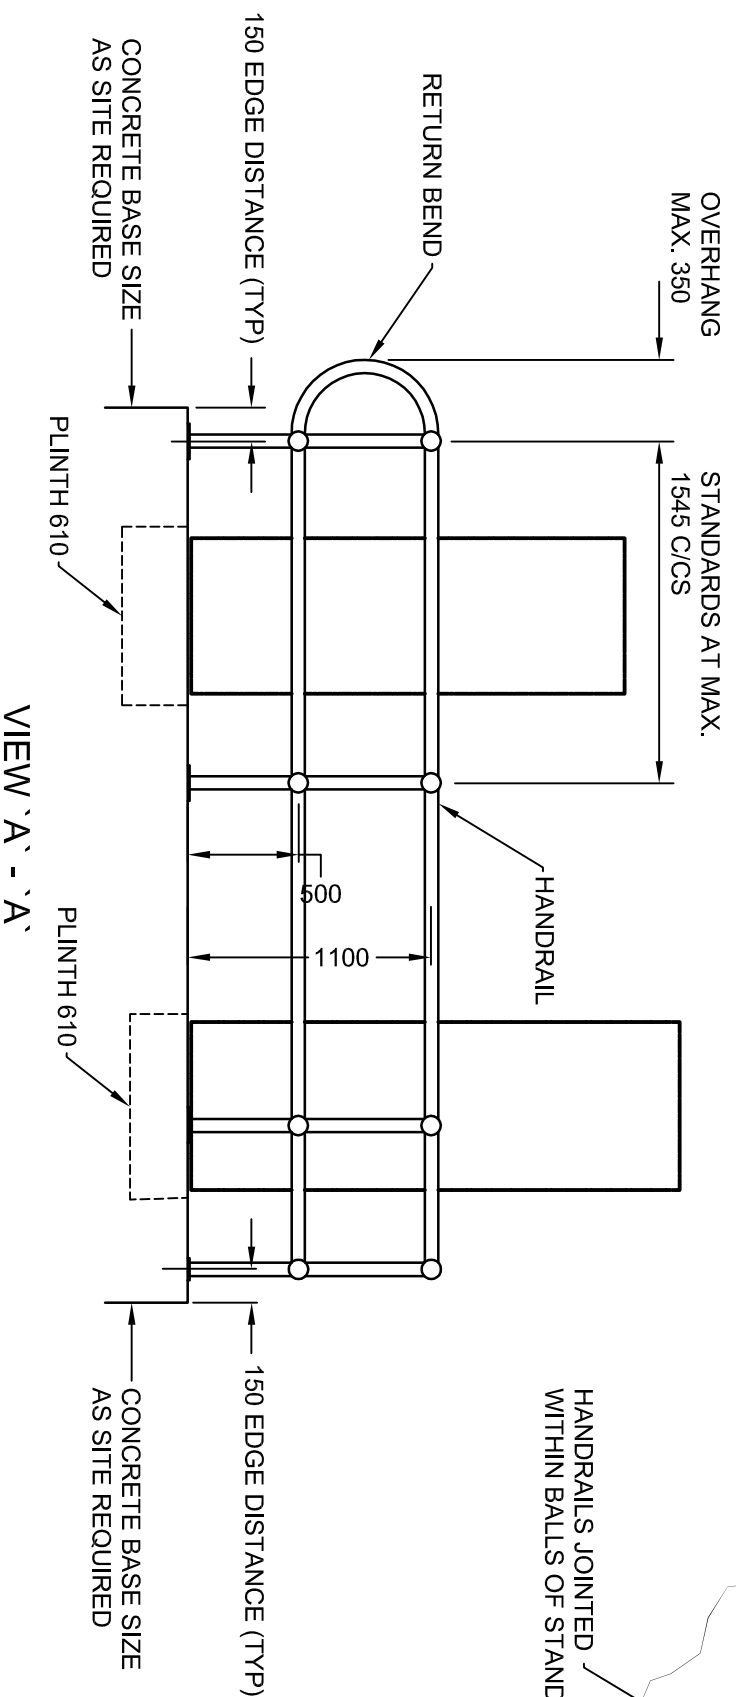


NOTES

1. The design and construction of the steps, including landings, handrails and other step and stairway elements shall comply with the recommendations of BS 5395.
2. Handrails required where there is a potential 'falling' hazard to site operatives eg. cabinets at top of embankments, slopes or ditches.
3. Handrail and standards to be galvanised M.S. tube to BS 1387 and to be 48.3 dia. with 90 dia. balls. Max. spacing of standards to be 1545mm.
4. Bases for standards to be bolt down type for use on concrete bases, horizontal or vertical as site required, using 16 dia. HT bolts or spigoted / cast in type at other locations.
5. Aluminium or Stainless Steel may be used and standard spacing amended accordingly.
6. Steps shall be constructed with reference to drawing NDX1070-01.

TYPICAL ARRANGEMENT OF HANDRAILS FOR STEPS AND CONCRETE CABINET BASES

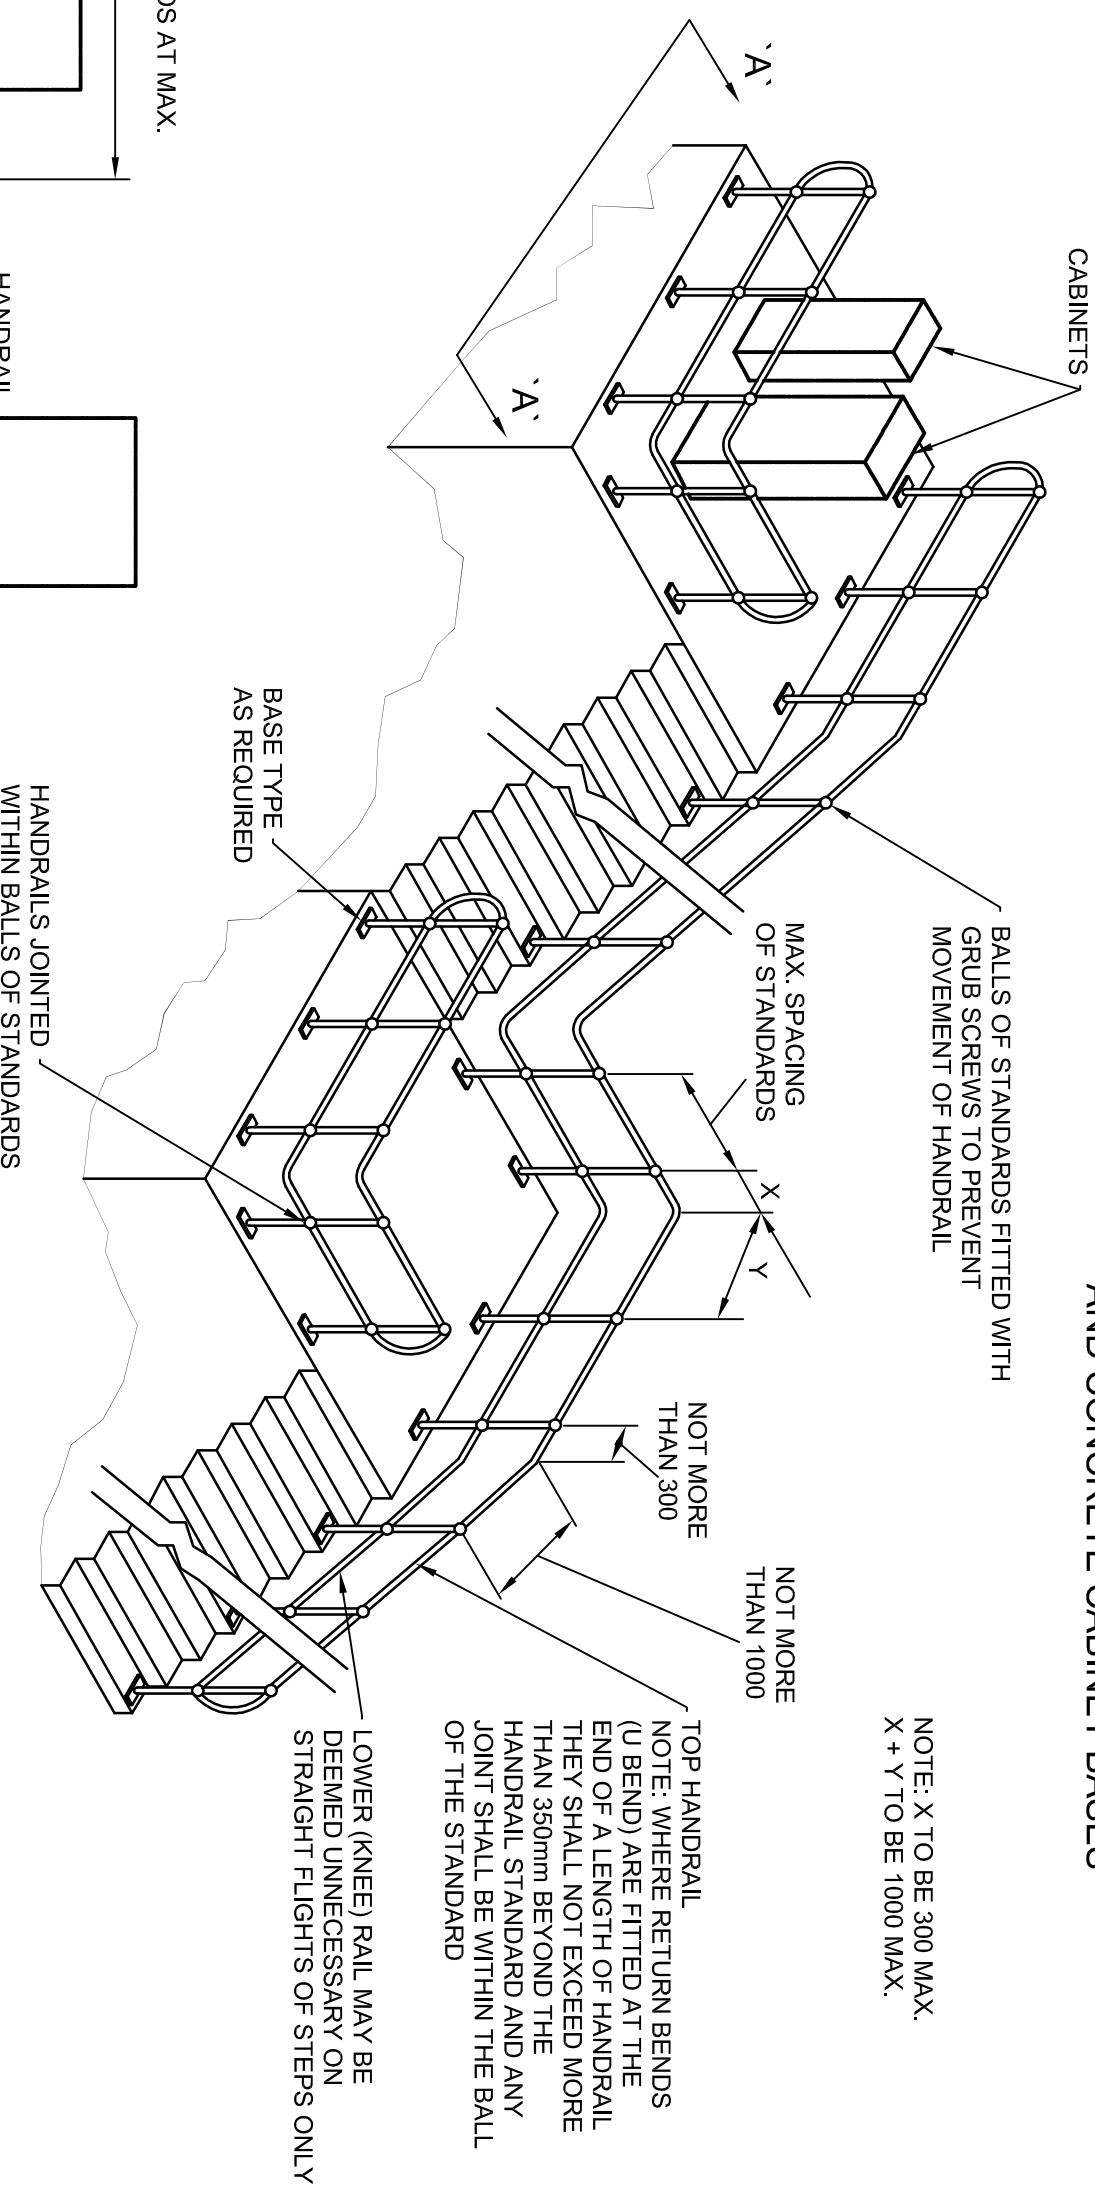

This drawing was generated on computer and must not be manually updated



Note:
The NDX series of drawings represents non site specific installations of standard equipment and site layouts.

TITLE		This drawing was generated on computer and must not be manually updated	
TYPICAL SITE ACCESS SAFETY HANDRAIL DETAIL			
ORIGINAL DRAWING SIZE: 297 x 420	DRN	C.S.G.	CHKD
ALL DIMENSIONS ARE IN MM	DATE	25.09.01	B.D.
TOLERANCE +/- 1 UNLESS OTHERWISE STATED	DRG. NO.	NDX1070-02ga	
THIRD ANGLE PROJECTION DO NOT SCALE	ISSUE	AMENDMENTS	APPD/DATE
	1	FIRST ISSUE	BD 07/12/01
	A	FOR INFORMATION	BD 09/02/03
	B	REDRAWN	BD 13/10/09
			SCALE
			N.T.S.
			SHT. NO.
			1 of 1