



Miekle
 Balloch
 Hill

Ord Hill

Cairn
 Hill

Cairnie

The Bin
 Forest

Coachford

Green
 Hill

Hill of
 Shenwall

Legend:

Scottish and Southern Energy

- Existing 132kV Overhead Cable
- Existing 33kV Overhead Cable
- Existing 33kV Underground Cable
- Existing Low Voltage Overhead Cable
- Existing Low Voltage Underground Cable
- Existing Scottish and Southern Telecom Cable

Scotia Gas Networks

- Existing Intermediate Pressure Main
- Existing Low Pressure Main
- Existing Medium Pressure Main
- Existing Local High Pressure Main

National Grid

- Existing High Pressure Transmission Line

Mobile Companies

- Vodafone Cable
- Everything Everywhere/H3G Mast

Wind Turbine

- Existing and Approved Wind Turbine Site Boundary (Note 3 and 4)
- Proposed Wind Turbine Site Boundary (Note 3 and 4)

- Notes:**
- The locations of private and publicly owned services and supply apparatus identified as existing, proposed, abandoned or temporary as shown on this drawing are purely indicative and for information only, and no guarantee is given to the completeness or accuracy of this information.
 - Prior to carrying out work in any part of the A96 Dualling Programme, all existing service and supply apparatus will need to be located and confirmed.
 - The locations of the Existing, Approved and Proposed Wind Turbines as shown on this drawing are purely indicative and for information only, and no guarantee is given to the completeness or accuracy of this information.
 - The hatching boundaries are indicative only and represent the area identified within the Wind Turbine Planning Applications.

0	04/03/15	Issued for information.	SA	SC	DB	EHB
Rev	Rev. Date	Purpose of revision	Drawn	Checked	Reviewed	Approved

JACOBS
 95 Bothwell St, Glasgow, G2 7HX
 Tel: +44(0)141 243 8000 Fax: +44(0)141 226 3109
 www.jacobs.com




**PUBLIC AND PRIVATE UTILITIES
 SHEET 23 OF 37**

Drawing status		
FOR INFORMATION		
Scale	1:10,000 @ A1	DO NOT SCALE
Jacobs No.	B1557621	
Drawing number	B1557621/2700/023	Rev
		0

File: P:\Data3\B1557621 - A96 PES\A96 CAD\2700 - A96 Utilities\B1557621-2700-023 Rev 0.dwg Date: Apr 21, 2015 - 10:08am Plotted by: henderst
 Reproduced by permission of Ordnance Survey on behalf of HMSO.
 © Crown copyright and database right 2015. All rights reserved.
 Ordnance Survey Licence number 100046666.

For continuation see drawing number B1557621/2700/024

For continuation see drawing number B1557621/2700/024

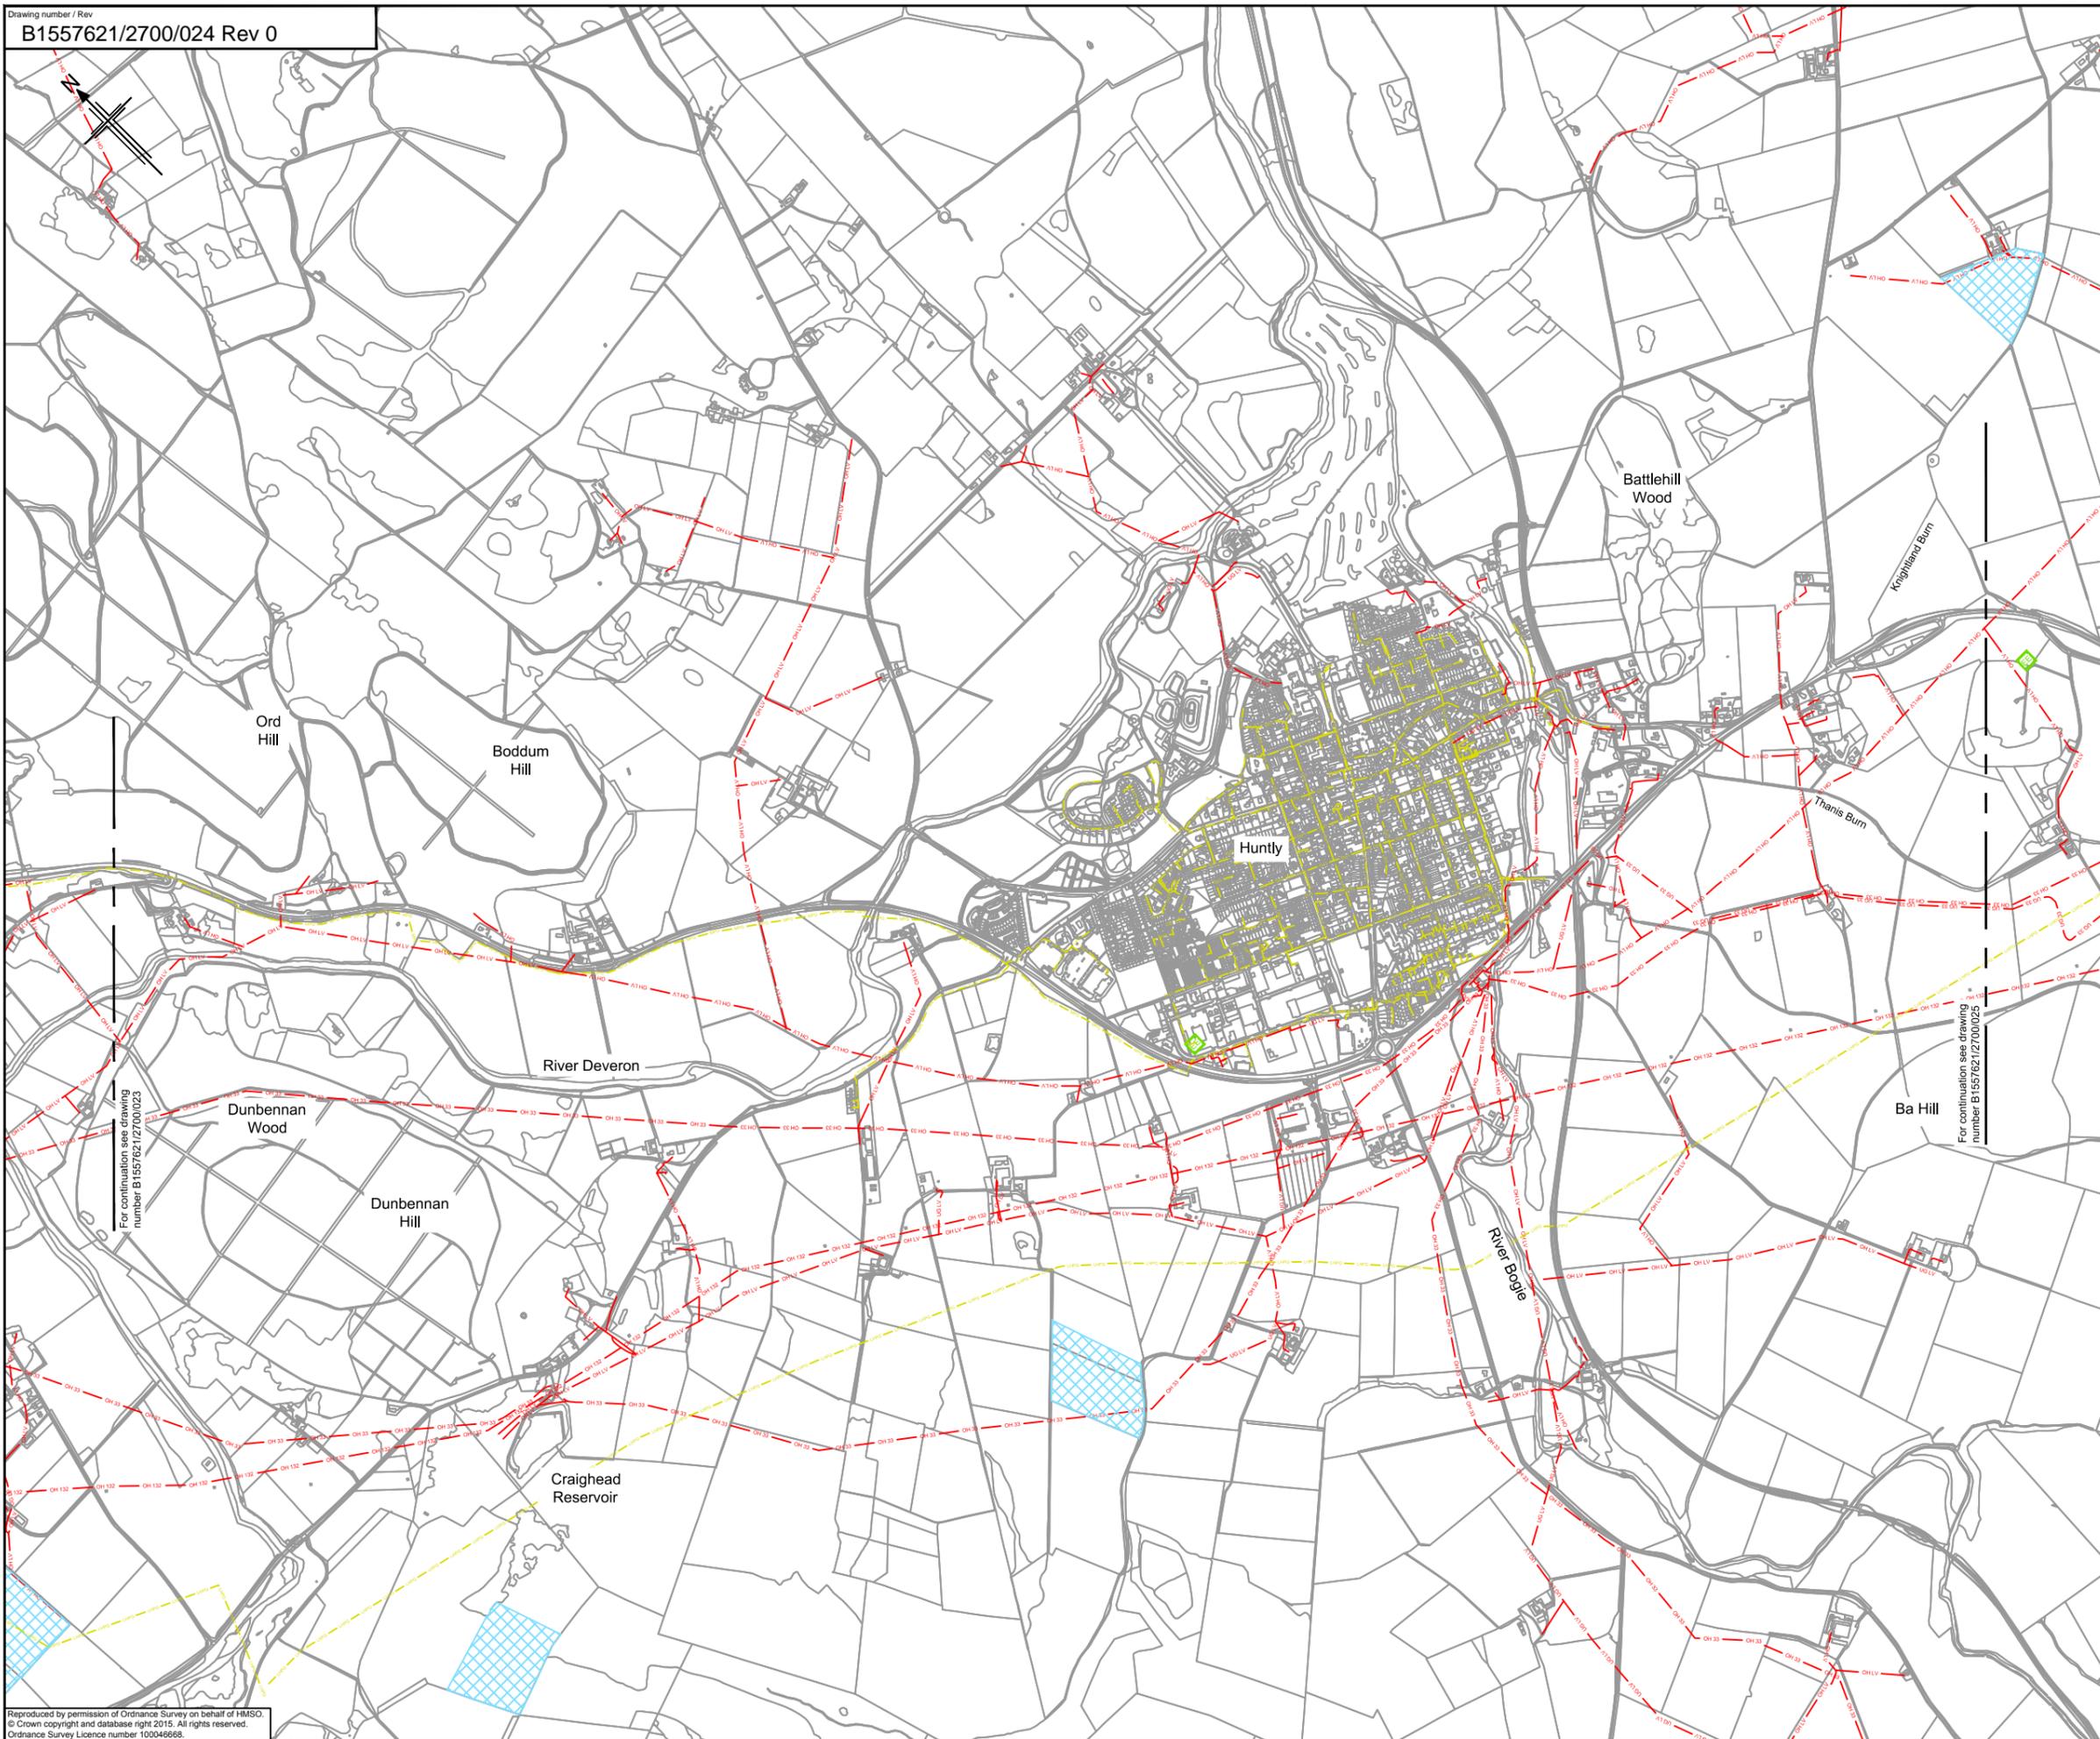

Legend:

Scottish and Southern Energy

- OH 132 Existing 132kV Overhead Cable
- OH 33 Existing 33kV Overhead Cable
- UG 33 Existing 33kV Underground Cable
- OH LV Existing Low Voltage Overhead Cable
- UG LV Existing Low Voltage Underground Cable
- SSE T Existing Scottish and Southern Telecom Cable

Scotia Gas Networks

- IPG Existing Intermediate Pressure Main
- LPG Existing Low Pressure Main
- MPG Existing Medium Pressure Main
- LHPG Existing Local High Pressure Main

National Grid

- HTPG Existing High Pressure Transmission Line

Mobile Companies

- Vodafone Cable
- Everything Everywhere/H3G Mast

Wind Turbine

- Existing and Approved Wind Turbine Site Boundary (Note 3 and 4)
- Proposed Wind Turbine Site Boundary (Note 3 and 4)

- Notes:**
- The locations of private and publicly owned services and supply apparatus identified as existing, proposed, abandoned or temporary as shown on this drawing are purely indicative and for information only, and no guarantee is given to the completeness or accuracy of this information.
 - Prior to carrying out work in any part of the A96 Dualling Programme, all existing service and supply apparatus will need to be located and confirmed.
 - The locations of the Existing, Approved and Proposed Wind Turbines as shown on this drawing are purely indicative and for information only, and no guarantee is given to the completeness or accuracy of this information.
 - The hatching boundaries are indicative only and represent the area identified within the Wind Turbine Planning Applications.

0	04/03/15	Issued for information.	SA	SC	DB	EHL
Rev	Rev. Date	Purpose of revision	Drawn	Checked	Reviewed	Approved

JACOBS
 95 Bothwell St, Glasgow, G2 7HX
 Tel: +44(0)141 243 8000 Fax: +44(0)141 226 3109
 www.jacobs.com




PUBLIC AND PRIVATE UTILITIES SHEET 24 OF 37

Drawing status		FOR INFORMATION	
Scale	1:10,000 @ A1	DO NOT SCALE	
Jacobs No.	B1557621		
Drawing number	B1557621/2700/024	Rev	0

This drawing is not to be used in whole or part other than for the intended purpose and project as defined on this drawing. Refer to the contract for full terms and conditions.

File: P:\Data\31\B1557621 - A96 PES\A96 CAD\2700 - A96 Utilities\B1557621-2700-024 Rev 0.dwg Date: Apr 21, 2015 - 10:11am Plotted by: henderst
 For continuation see drawing number B1557621/2700/023
 For continuation see drawing number B1557621/2700/025

Reproduced by permission of Ordnance Survey on behalf of HMSO.
 © Crown copyright and database right 2015. All rights reserved.
 Ordnance Survey Licence number 100046666.

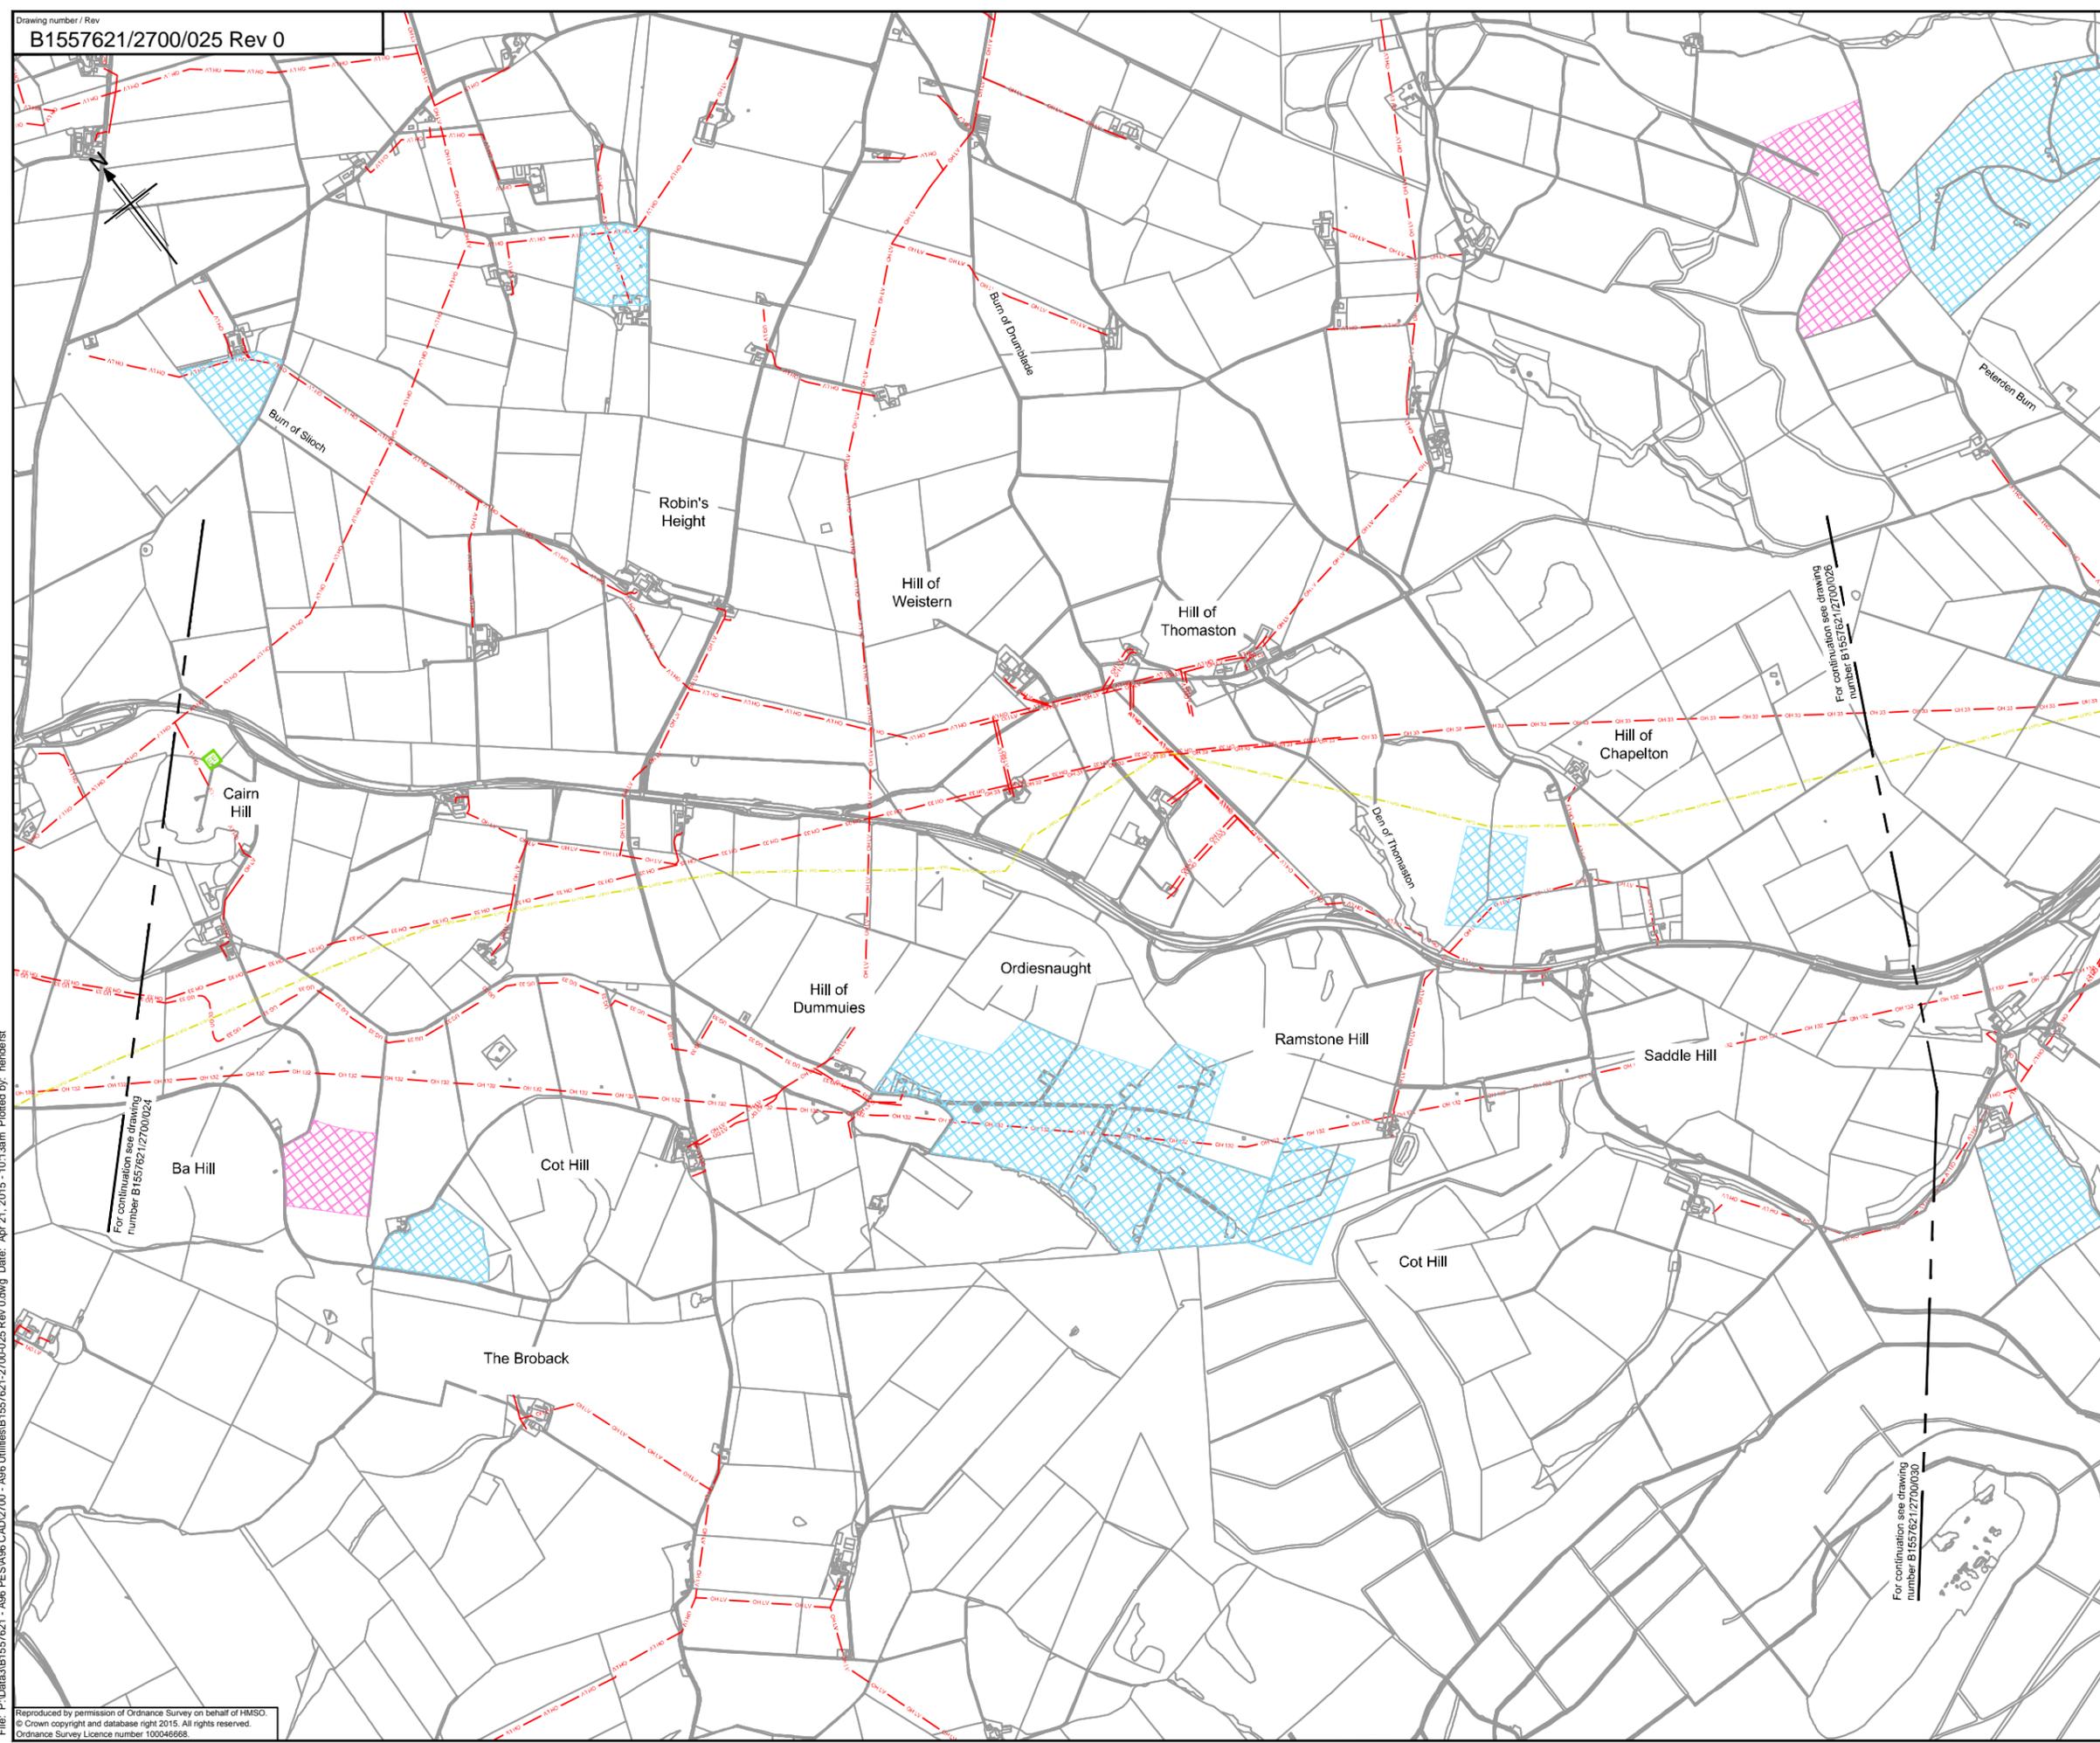

Legend:

Scottish and Southern Energy

- OH 132 Existing 132kV Overhead Cable
- OH 33 Existing 33kV Overhead Cable
- UB 33 Existing 33kV Underground Cable
- OH LV Existing Low Voltage Overhead Cable
- UB LV Existing Low Voltage Underground Cable
- SSTF Existing Scottish and Southern Telecom Cable

Scotia Gas Networks

- IPG Existing Intermediate Pressure Main
- LPD Existing Low Pressure Main
- MPD Existing Medium Pressure Main
- LPD Existing Local High Pressure Main

National Grid

- EHPS Existing High Pressure Transmission Line

Mobile Companies

- Vodafone Cable
- Everything Everywhere/H3G Mast

Wind Turbine

- Existing and Approved Wind Turbine Site Boundary (Note 3 and 4)
- Proposed Wind Turbine Site Boundary (Note 3 and 4)

- Notes:**
- The locations of private and publicly owned services and supply apparatus identified as existing, proposed, abandoned or temporary as shown on this drawing are purely indicative and for information only, and no guarantee is given to the completeness or accuracy of this information.
 - Prior to carrying out work in any part of the A96 Dualling Programme, all existing service and supply apparatus will need to be located and confirmed.
 - The locations of the Existing, Approved and Proposed Wind Turbines as shown on this drawing are purely indicative and for information only, and no guarantee is given to the completeness or accuracy of this information.
 - The hatching boundaries are indicative only and represent the area identified within the Wind Turbine Planning Applications.

Rev	Rev. Date	Purpose of revision	SA	SC	DB	EH
0	04/03/15	Issued for information				

JACOBS
 95 Bothwell St, Glasgow, G2 7HX
 Tel: +44(0)141 243 8000 Fax: +44(0)141 226 3109
 www.jacobs.com

Client

TRANSPORT SCOTLAND
 COMH-DHAL ALBA

Project

A96 DUALLING
 BUSINESS TO PROGRESS

Drawing title
PUBLIC AND PRIVATE UTILITIES SHEET 25 OF 37

Drawing status: **FOR INFORMATION**

Scale	1:10,000 @ A1	DO NOT SCALE
Jacobs No.	B1557621	
Drawing number	B1557621/2700/025	Rev
		0


This drawing is not to be used in whole or part other than for the intended purpose and project as defined on this drawing. Refer to the contract for full terms and conditions.

File: P:\Data\3\B1557621 - A96 PES\A96 CAD\2700 - A96 Utilities\B1557621-2700-025 Rev 0.dwg Date: Apr 21, 2015 - 10:13am Plotted by: henderst
 Reproduced by permission of Ordnance Survey on behalf of HMSO.
 © Crown copyright and database right 2015. All rights reserved.
 Ordnance Survey Licence number 100046668.

For continuation see drawing number B1557621/2700/024

For continuation see drawing number B1557621/2700/026

For continuation see drawing number B1557621/2700/020

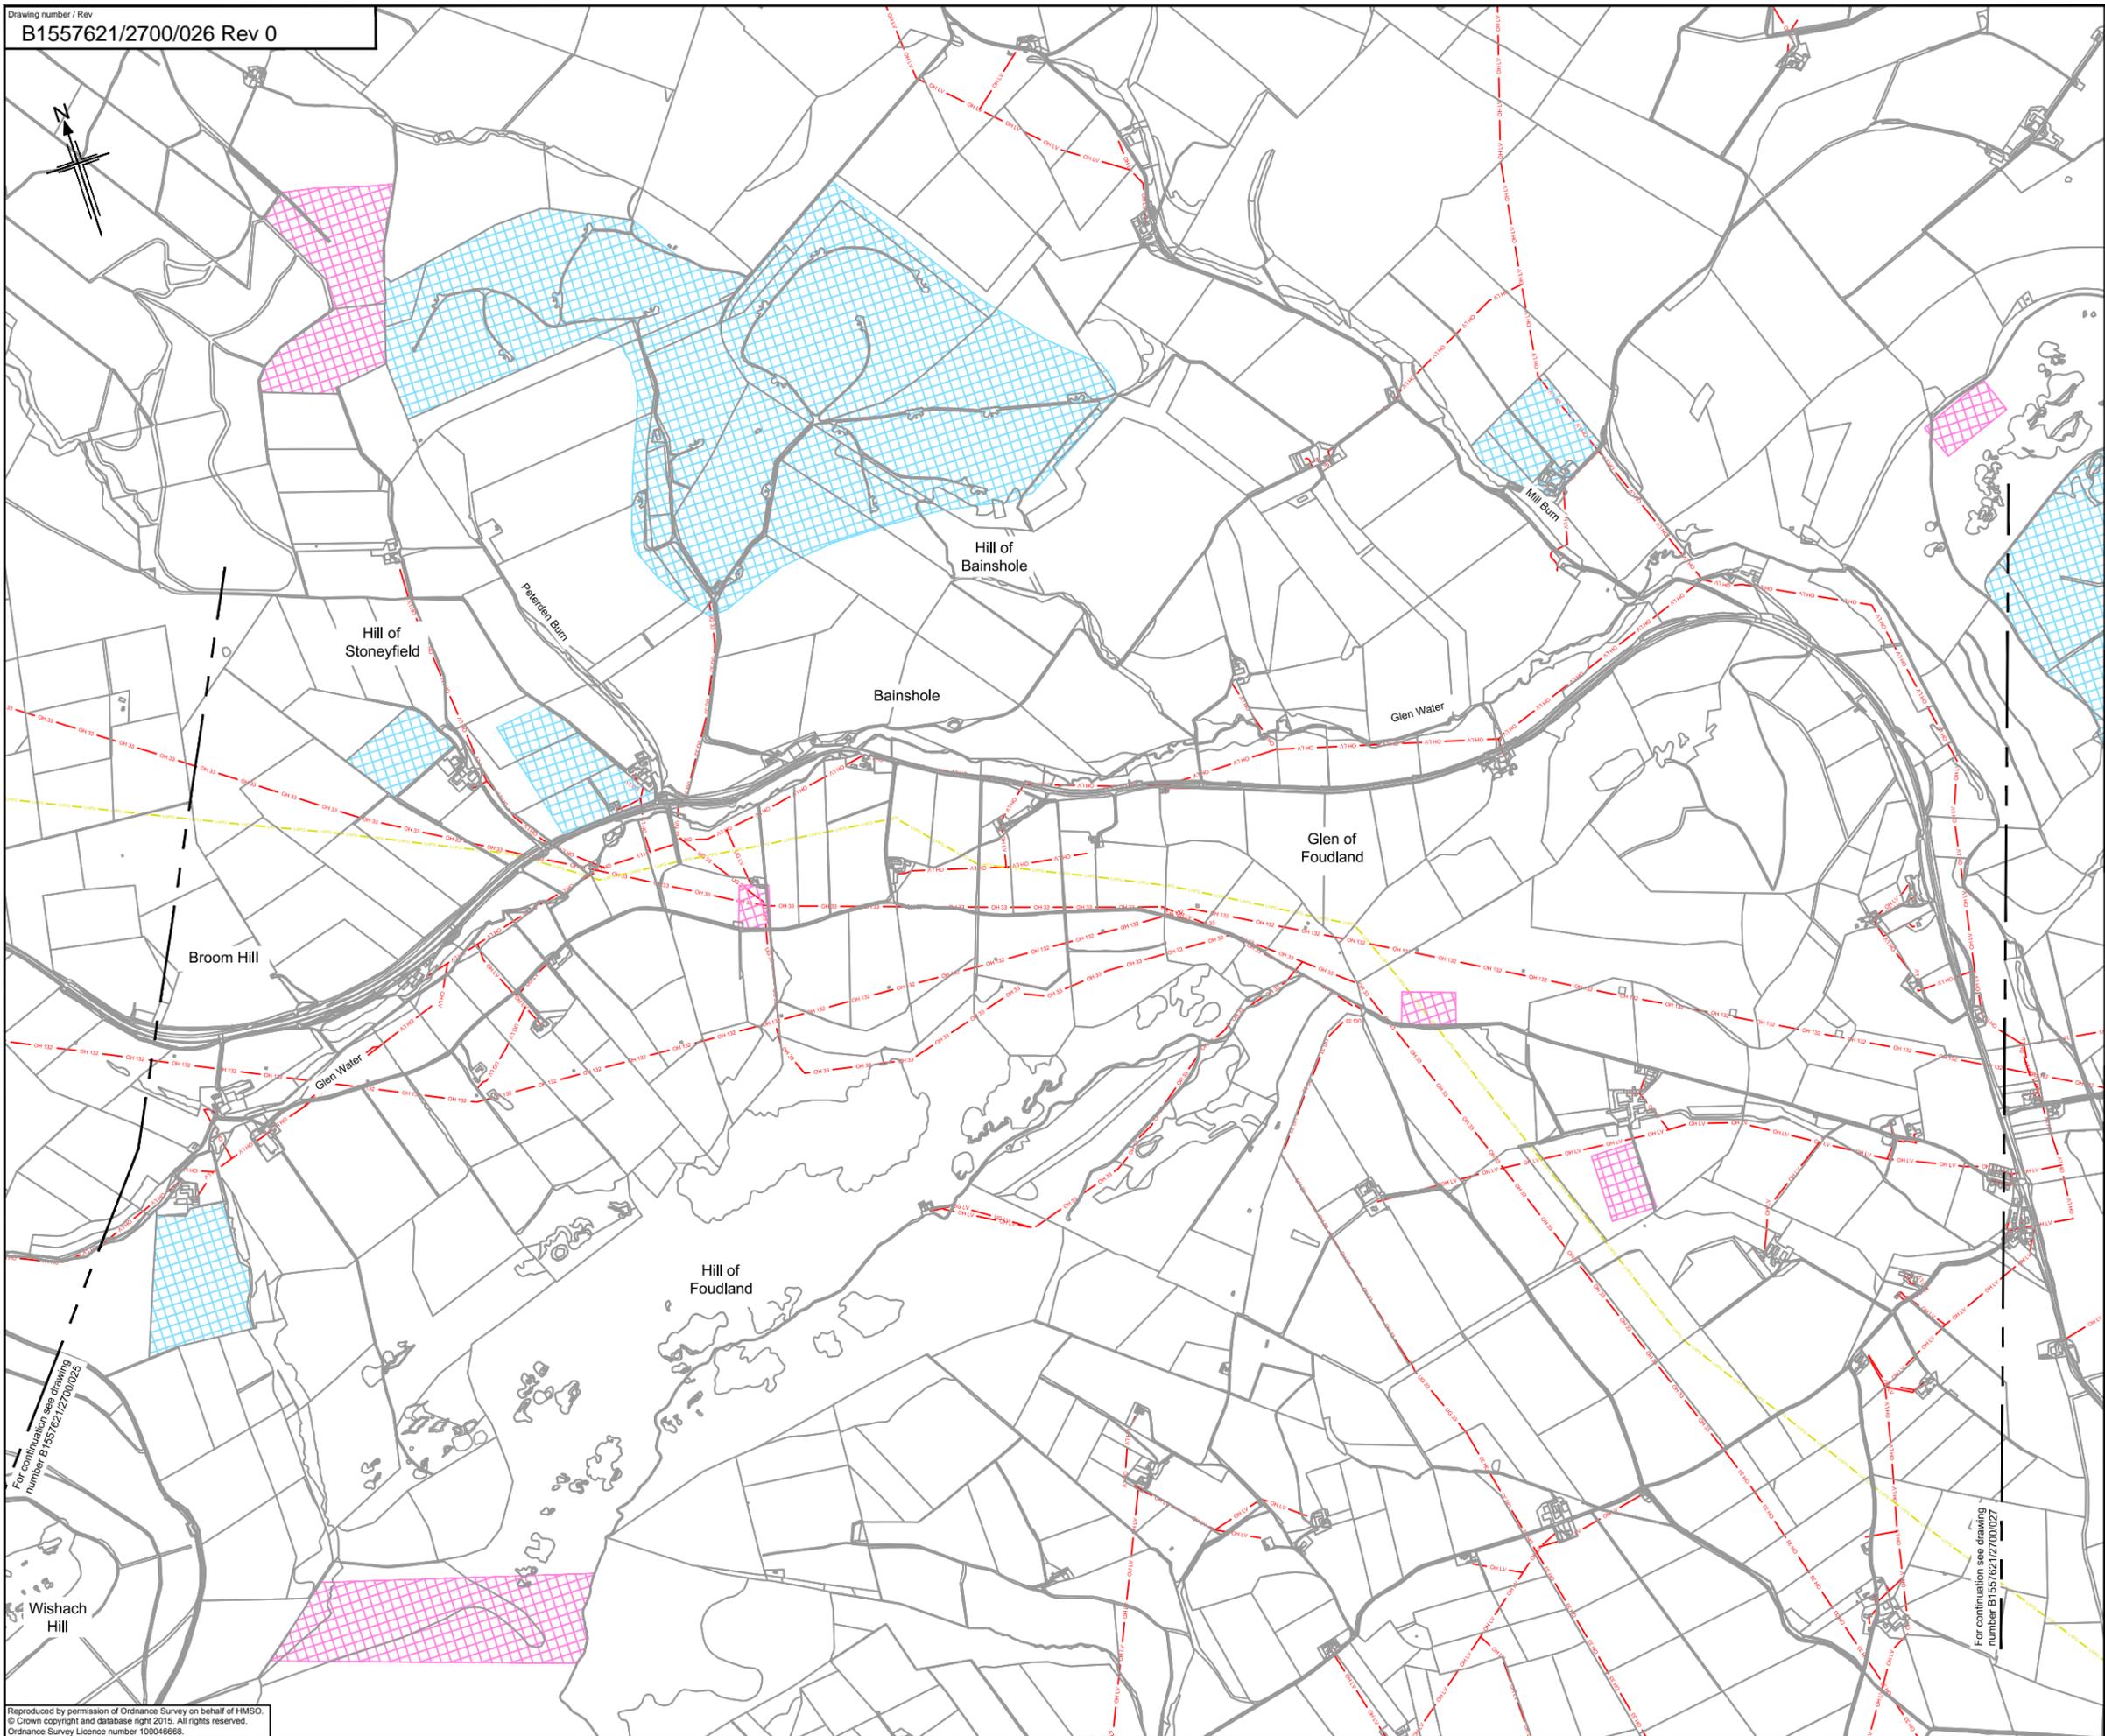

Legend:

Scottish and Southern Energy

- OH 132 Existing 132kV Overhead Cable
- OH 33 Existing 33kV Overhead Cable
- UG 33 Existing 33kV Underground Cable
- OH LV Existing Low Voltage Overhead Cable
- UG LV Existing Low Voltage Underground Cable
- SSE T Existing Scottish and Southern Telecom Cable

Scotia Gas Networks

- IPG Existing Intermediate Pressure Main
- LPG Existing Low Pressure Main
- MPG Existing Medium Pressure Main
- LHPG Existing Local High Pressure Main

National Grid

- HPG Existing High Pressure Transmission Line

Mobile Companies

- Vodafone Cable
- Everything Everywhere/H3G Mast

Wind Turbine

- Existing and Approved Wind Turbine Site Boundary (Note 3 and 4)
- Proposed Wind Turbine Site Boundary (Note 3 and 4)

- Notes:**
- The locations of private and publicly owned services and supply apparatus identified as existing, proposed, abandoned or temporary as shown on this drawing are purely indicative and for information only, and no guarantee is given to the completeness or accuracy of this information.
 - Prior to carrying out work in any part of the A96 Dualling Programme, all existing service and supply apparatus will need to be located and confirmed.
 - The locations of the Existing, Approved and Proposed Wind Turbines as shown on this drawing are purely indicative and for information only, and no guarantee is given to the completeness or accuracy of this information.
 - The hatching boundaries are indicative only and represent the area identified within the Wind Turbine Planning Applications.

Rev	Rev. Date	Purpose of revision	SA	SC	DB	EHL
0	04/03/15	Issued for information.				



Drawing title
PUBLIC AND PRIVATE UTILITIES SHEET 26 OF 37

Drawing status
FOR INFORMATION

Scale	1:10,000 @ A1	DO NOT SCALE
Jacobs No.	B1557621	

Drawing number	B1557621/2700/026	Rev	0
----------------	-------------------	-----	---

This drawing is not to be used in whole or part other than for the intended purpose and project as defined on this drawing. Refer to the contract for full terms and conditions.

File: P:\Data\B1557621 - A96 PES\A96 CAD\2700 - A96 Utilities\B1557621-2700-026 Rev 0.dwg Date: Apr 21, 2015 - 10:16am Plotted by: henderst
 For continuation see drawing number B1557621/2700/025
 For continuation see drawing number B1557621/2700/027

Reproduced by permission of Ordnance Survey on behalf of HMSO.
 © Crown copyright and database right 2015. All rights reserved.
 Ordnance Survey Licence number 100046666.