


Redacted

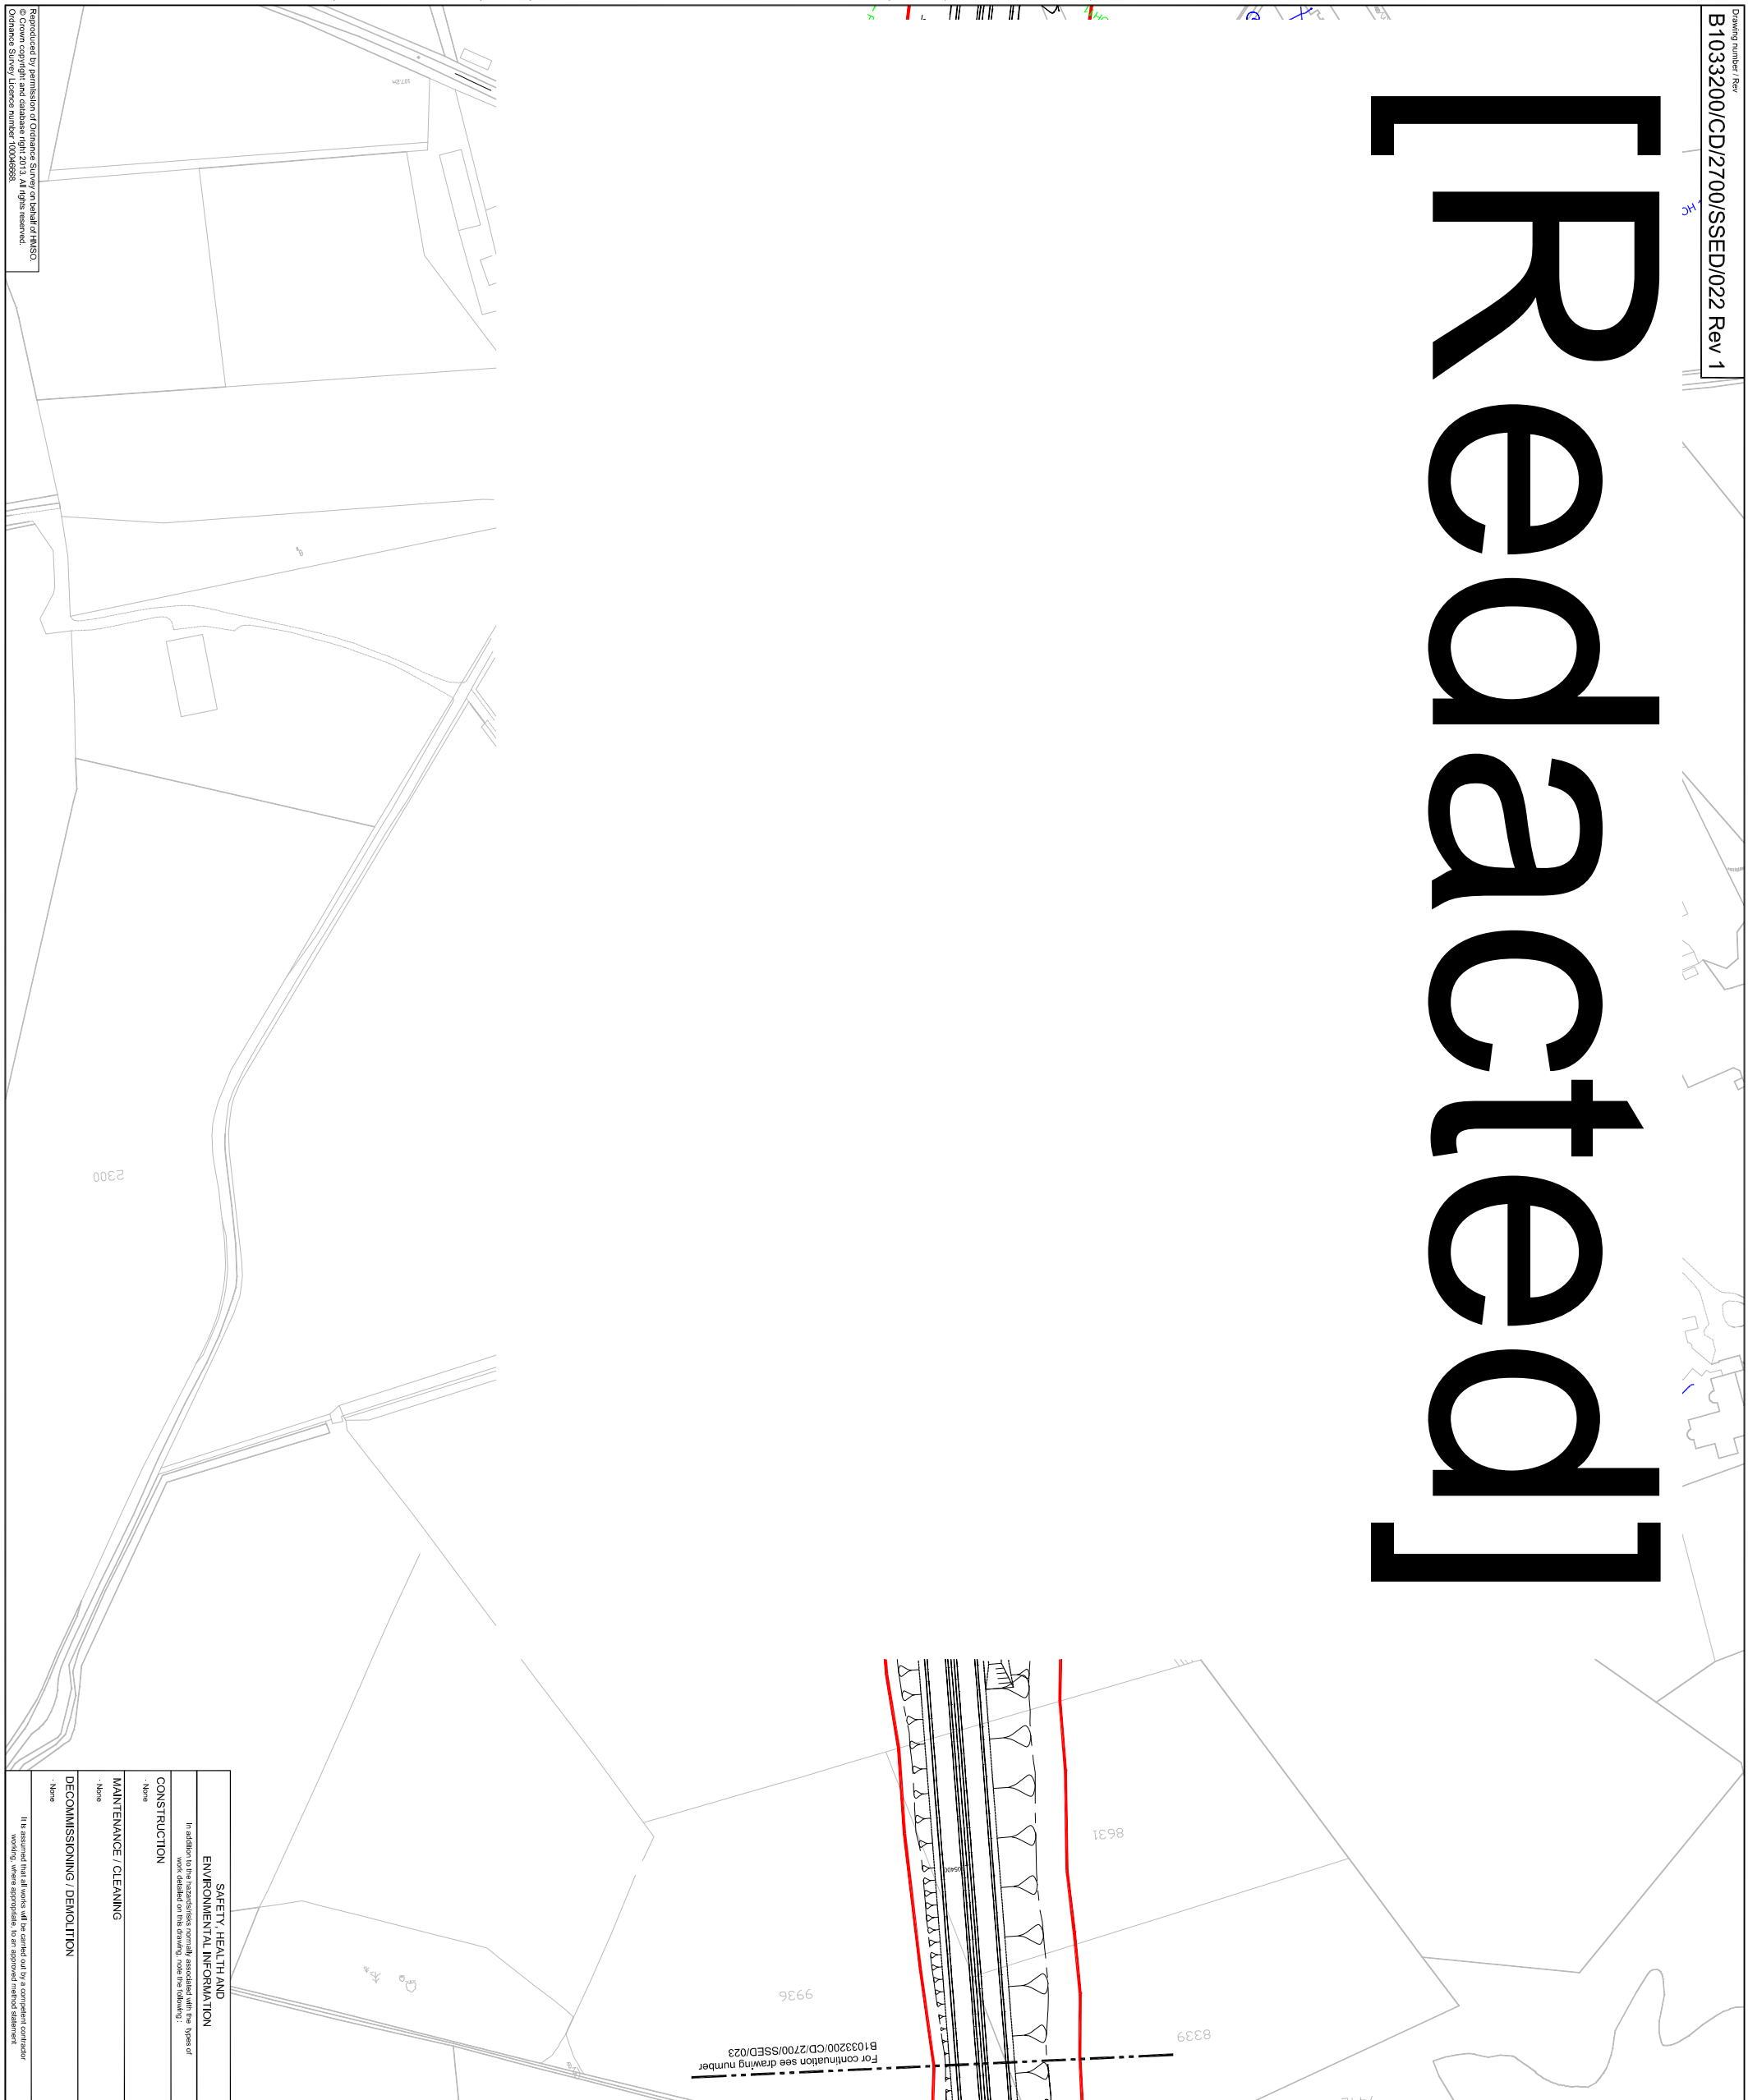

Notes:

- The locations of private and publicly owned service and supply apparatus identified as existing, proposed, abandoned or temporary only, on this drawing are purely indicative and information only. No guarantee is given to the completeness or accuracy of this information.
- Prior to carrying out work in any part of the site, the Contractor shall be responsible for locating all existing service and supply apparatus, and agreeing the details of any required diversion and protection measures with the relevant Company or Landowner.
- For details of existing undertaker apparatus refer to drawing series B1033200/CD/2700/EX/##.

Legend:

- Land made available
 - SSED #/# Contract Reference
 - (##) Undertaker Reference
- Existing Apparatus:**
- OH 33 — 33kV Overhead Line
 - UG 33 — 33kV Underground Cable
 - OH 11 — 11kV Overhead Line
 - UG 11 — 11kV Underground Cable
 - OH 415 — 415V Overhead Line
 - UG 415 — 415V Underground Cable
 - Underground Cable Joint / Box
 - Overhead Line Pole / Switch / Transformer

Proposed Apparatus:

- P-OH33 — 33kV Overhead Line
- P-U33 — 33kV Underground Cable
- P-OH11 — 11kV Overhead Line
- P-UG11 — 11kV Underground Cable
- P-OH415 — 415V Overhead Line
- P-UG415 — 415V Underground Cable

Abandoned Apparatus:

- A-OH33 — 33kV Overhead Line
- A-U33 — 33kV Underground Cable
- A-OH11 — 11kV Overhead Line
- A-UG11 — 11kV Underground Cable
- A-OH415 — 415V Overhead Line
- A-UG415 — 415V Underground Cable

Temporary Apparatus:

- T-OH33 — 33kV Overhead Line
- T-U33 — 33kV Underground Cable
- T-OH11 — 11kV Overhead Line
- T-UG11 — 11kV Underground Cable
- T-OH415 — 415V Overhead Line
- T-UG415 — 415V Underground Cable

Rev.	Rev. Date	Rev. Description	Drawn	Checked	Rev'd	Appr'd
1	30/06/13	Final Record column updated	BA	CRP	BM	JAK
0	14/06/13	For dialogue	BA	CRP	BM	JAK

JACOBS
 95 Bowling St. Glasgow, G2 7JX
 Tel: +44(0)141 243 2000 Fax: +44(0)141 228 9109
 www.jacobs.com

berdeen Western Peripheral Route
 Balmedie-Tipperary

Drawing title
**INDICATIVE DESIGN
 SCOTTISH & SOUTHERN ENERGY
 DISTRIBUTION
 SHEET 22 OF 71**

Drawing status		FOR DIALOGUE		DO NOT SCALE	
Scale	1:1,250 @ A1	Jacobs No.	B1033200	Drawing number	B1033200/CD/2700/SSED/022
Decommissioning / Demolition	None	Revision	1	Revision	1

Reproduced by permission of Ordnance Survey on behalf of HMSO.
 © Crown copyright and database right 2013. All rights reserved.
 Ordnance Survey Licence number: 100045883