


Redacted

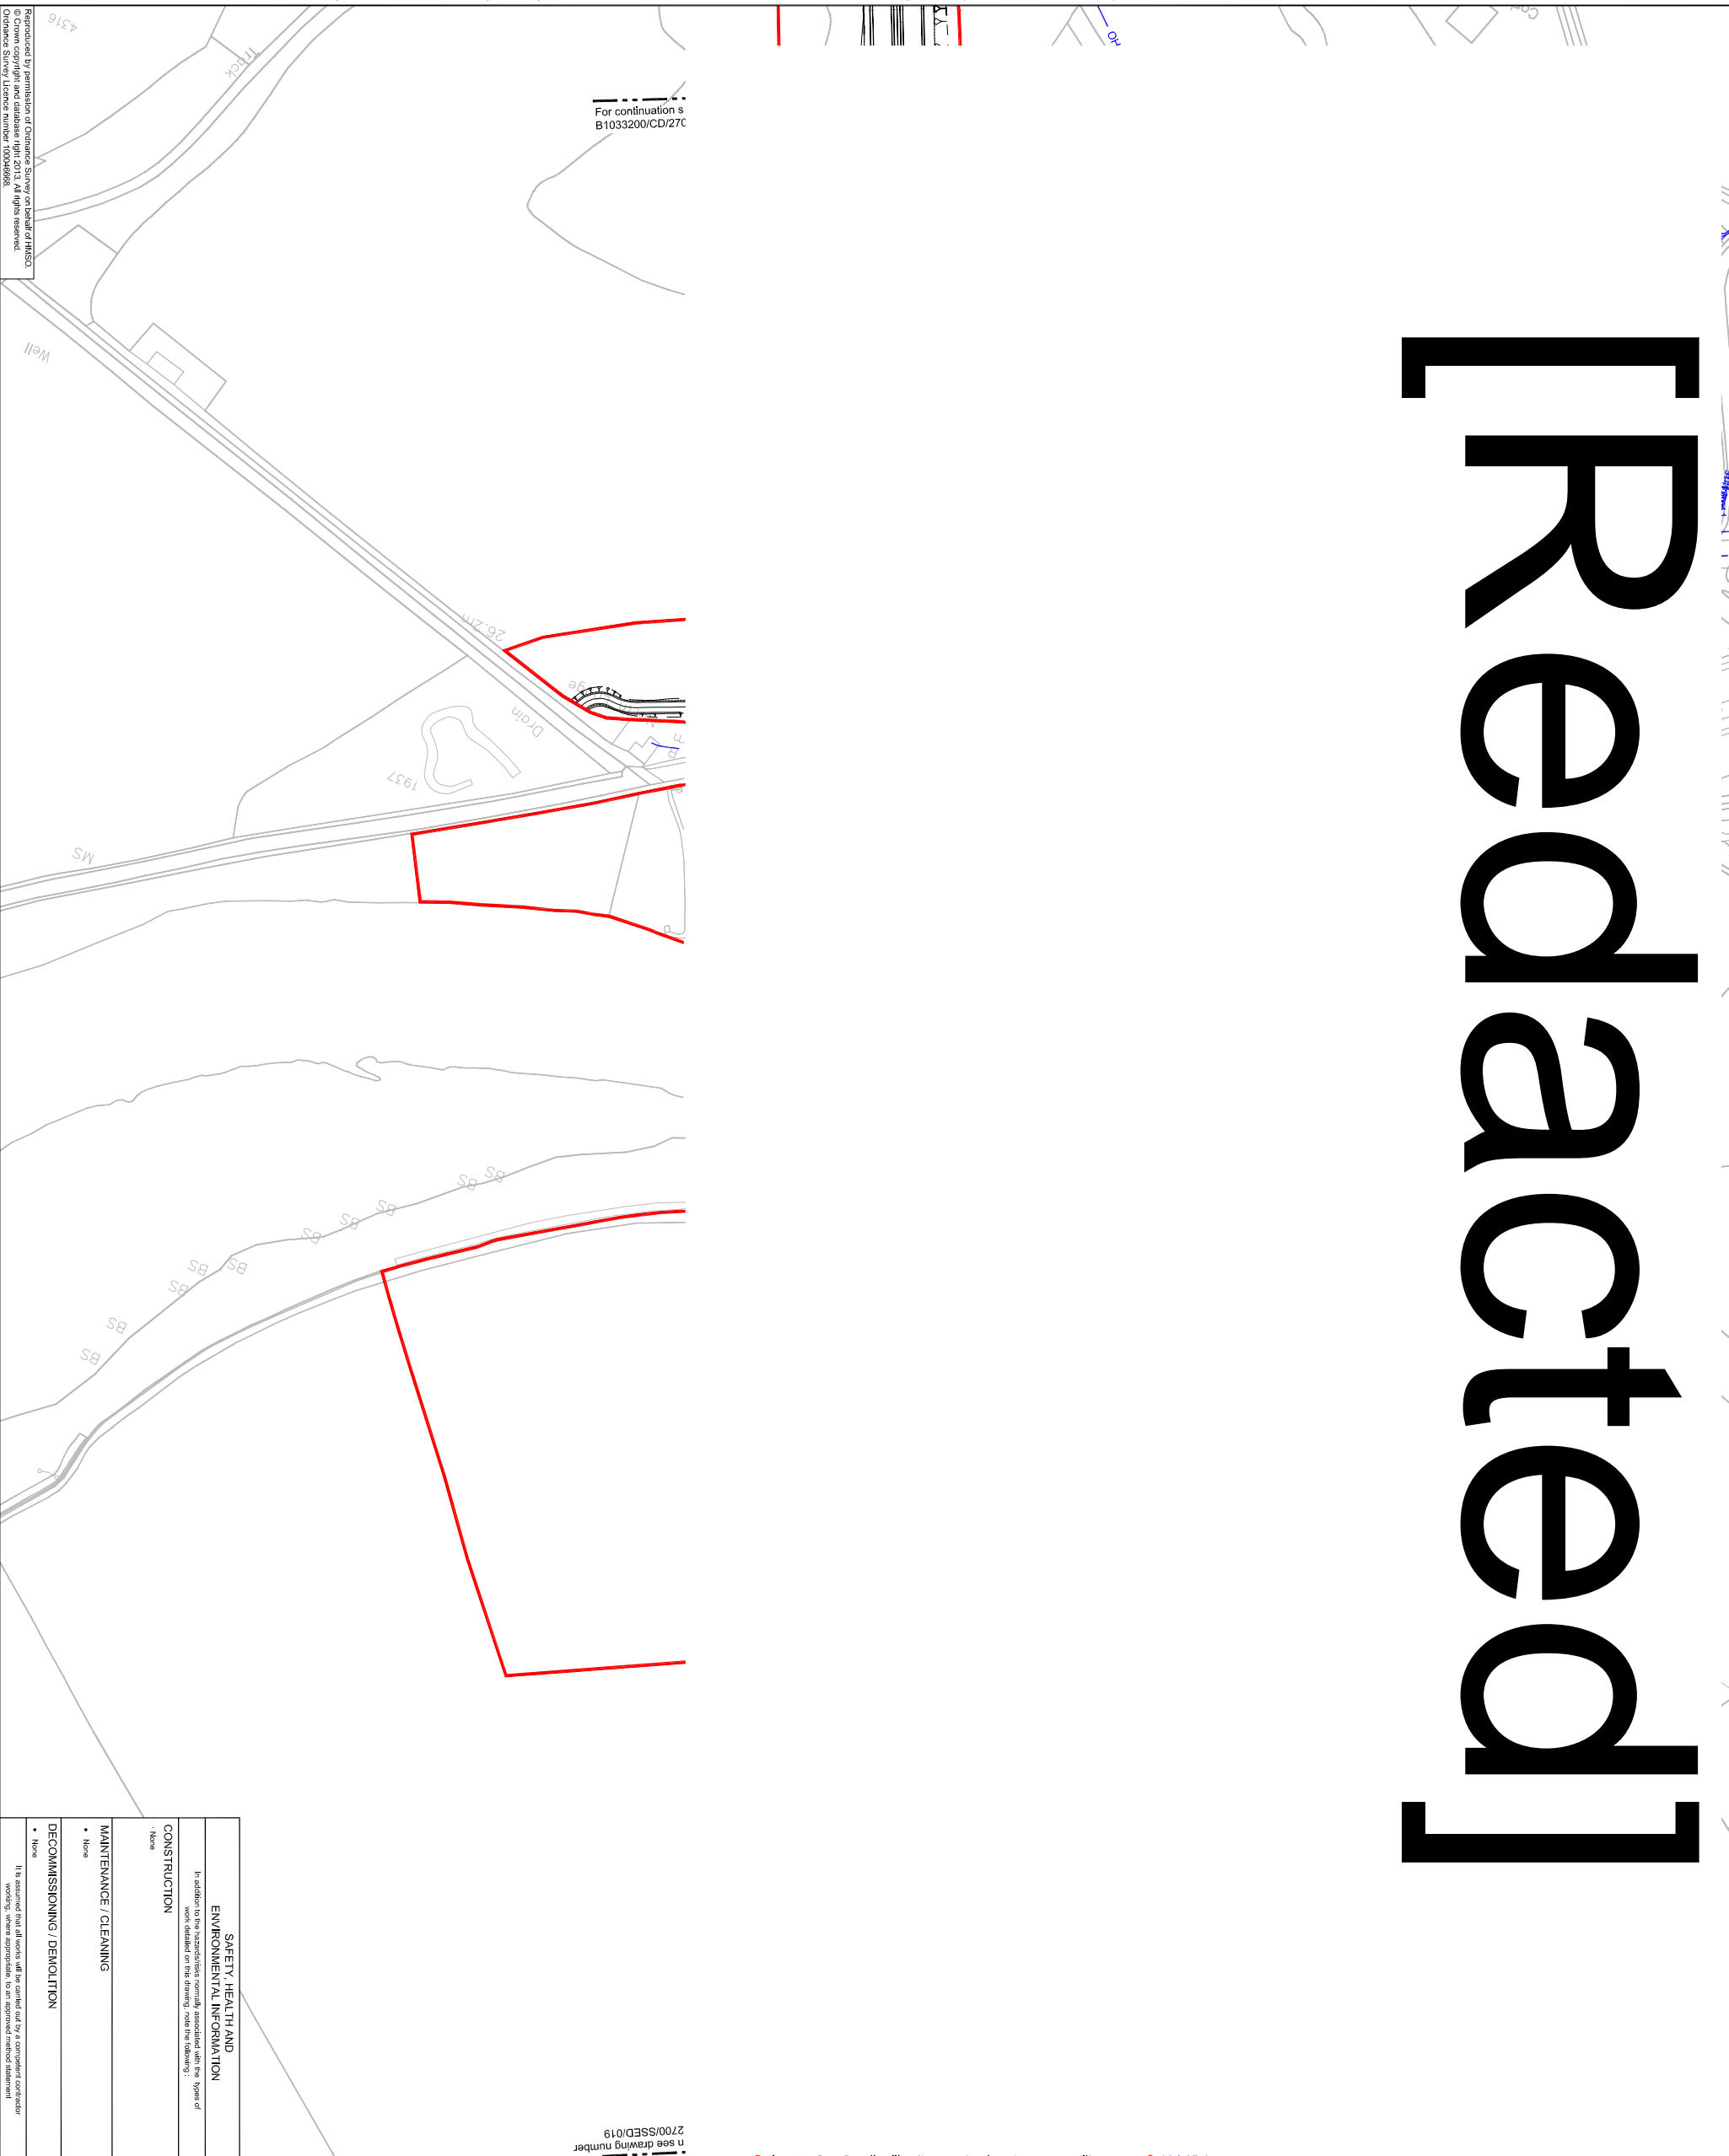

2700/SSED/019
 n see drawing number

For continuation s
 B1033200/CD/2700

Notes:

- The locations of private and publicly owned services and supply apparatus identified as existing, proposed, abandoned or temporary only, and on this drawing are partly indicative and information only and no guarantee is given to the completeness or accuracy of this information.
- Prior to carrying out work in any part of the site, the Contractor shall be responsible for locating all existing service and supply apparatus, and agreeing the details of any required diversion and protection measures with the relevant Company or Landowner.
- For details of existing undertaker apparatus refer to drawing series B1033200/CD/2700/EX/##.

Legend:

- Land made available
 - SSED #/## — Contract Reference
 - (##) — Undertaker Reference
- Existing Apparatus:**
- OH 33 — - 33kV Overhead Line
 - UG 33 — - 33kV Underground Cable
 - OH 11 — - 11kV Overhead Line
 - UG 11 — - 11kV Underground Cable
 - OH 415 — - 415V Overhead Line
 - UG 415 — - 415V Underground Cable
 - — Underground Cable Joint / Box
 - — Overhead Line Pole / Switch / Transformer

Proposed Apparatus:

- P-OH33 — - 33kV Overhead Line
- P-UG33 — - 33kV Underground Cable
- P-OH11 — - 11kV Overhead Line
- P-UG11 — - 11kV Underground Cable
- P-OH415 — - 415V Overhead Line
- P-UG415 — - 415V Underground Cable

Abandoned Apparatus:

- A-OH33 — - 33kV Overhead Line
- A-UG33 — - 33kV Underground Cable
- A-OH11 — - 11kV Overhead Line
- A-UG11 — - 11kV Underground Cable
- A-OH415 — - 415V Overhead Line
- A-UG415 — - 415V Underground Cable

Temporary Apparatus:

- T-OH33 — - 33kV Overhead Line
- T-UG33 — - 33kV Underground Cable
- T-OH11 — - 11kV Overhead Line
- T-UG11 — - 11kV Underground Cable
- T-OH415 — - 415V Overhead Line
- T-UG415 — - 415V Underground Cable

Rev.	Rev. Date	Purpose of revision	Drawn	Checked	Rev'd	Approved
1	30/05/13	Final layout colours updated	BA	CRP	BM	JAK
0	14/05/13	For dialogue	BA	CRP	BM	JAK

JACOBS
 95 Bonwell St, Glasgow, G2 7JX
 Tel: +44(0)141 243 2000 Fax: +44(0)141 228 9109
 www.jacobs.com

Aberdeen Western Peripheral Route
 Balmudie-Tipperary

INDICATIVE DESIGN
SCOTTISH & SOUTHERN ENERGY
DISTRIBUTION
SHEET 18 OF 71

FOR DIALOGUE
 Scale: 1:1,250 @ A1
 DO NOT SCALE
 Drawing number: B1033200
 Jacobs No: B1033200
 Drawing number: B1033200/CD/2700/SSED/018
 Rev: 1

Reproduced by permission of Ordnance Survey on behalf of HMSO.
 © Crown copyright and database right 2013. All rights reserved.
 Ordnance Survey Licence number: 100035555

File: P:\Data\3\0010332 - Aberdeen Western Peripheral Route\Project Data\Cad\Specimen Design Drawings\2700 - Utilities\SSE Distribution\B1033200-CD-2700-SSED-018 Rev1.dwg Date: May 30, 2013 - 10:28am Plotted by: adam