


- NOTES
1. Minimum bending radii of the cables shall be adhered to. (12 x diameter)
  2. Cables shall only be installed into the duct allocated. The orientation of duct maintained throughout.

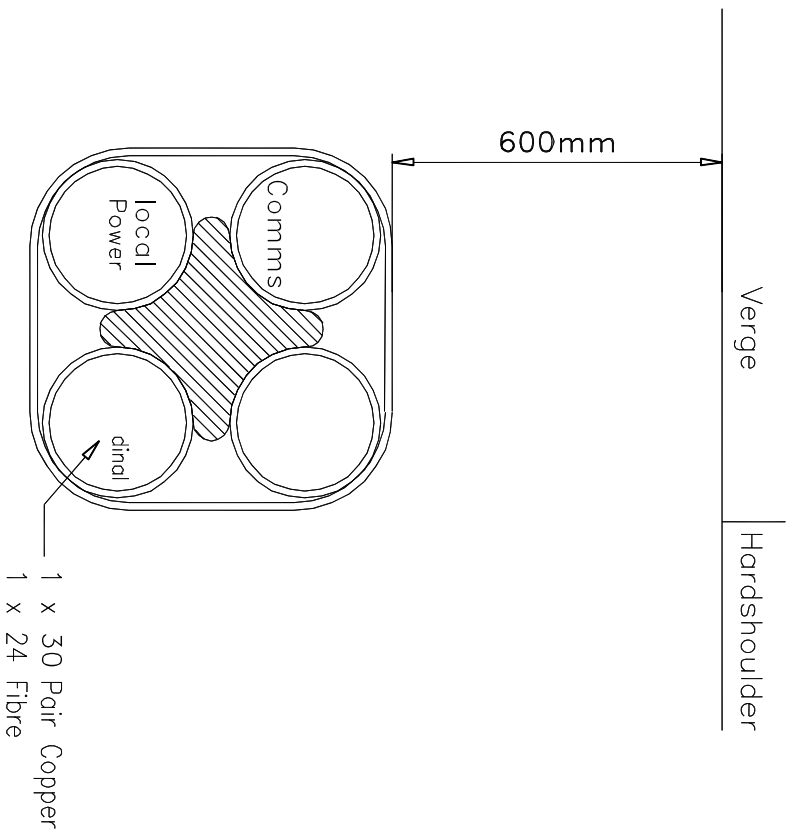

SECTION THROUGH  
LONGITUDINAL  
DUCT ARRANGEMENT  
(Note 4)

This drawing was generated on computer and must not be manually updated

TITLE LONGITUDINAL DUCT CABLE ALLOCATION

ORIGINAL DRAWING SIZE: 297 x 420	DRN C.S.G.	CHKD B.D.	SCALE
ALL DIMENSIONS ARE IN MM	DATE 25.09.01	DATE 29.09.01	N.T.S.
TOLERANCE ± 1 UNLESS OTHERWISE STATED	DRG. NO. <b>NDX1063-00dt</b>		SHT. NO. 8 of 10
THIRD ANGLE PROJECTION DO NOT SCALE			
	ISSUE	AMENDMENTS	APPD./DATE
B	SEE REVIEW SHEET		GC 28/9/06
A	FOR CONSTRUCTION		BD 09.02.2005
I	FIRST ISSUE		BD 07.12.2001